


\* **NOTE:**  
For reference in placing new curb stops  
and relocated curb boxes see L-9901.

**Detail "A"**  
(w/ Sidewalk)

\*\* **NOTE:**  
Should Poly tubing, Galvanized or Lead  
material be encountered the entire  
Service Line shall be replaced w/ Copper  
from the existing Corporation Stop to  
the new Curb Stop. Pipe shall be Copper  
Tubing Size (C.T.S.).

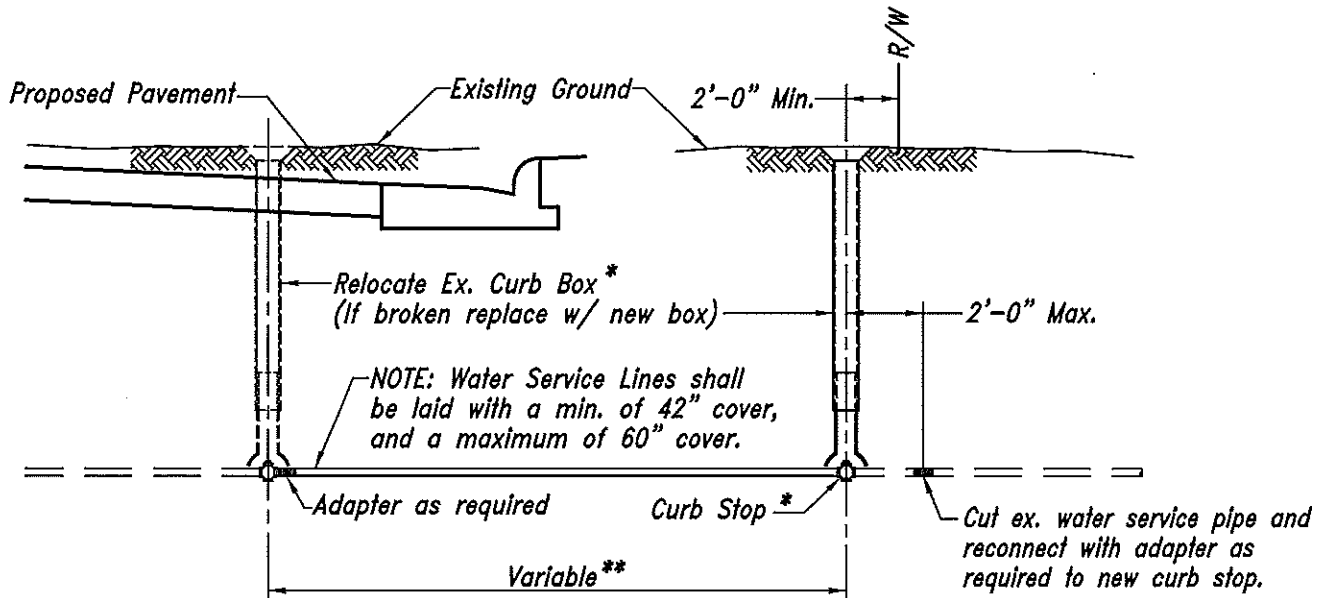

**Detail "B"**  
(w/o Sidewalk)

L-7102A.Dwg Revision Date: 1/2/13

CITY OF COLUMBUS DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER		STANDARD DETAIL WATER SERVICE EXTENSION AND CURB BOX RELOCATION		
APPROVED:	DATE			
 ADMINISTRATOR	5-16-13			